

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT



TABLE OF CONTENTS

INTRODUCTION..... 3

DEFINING THE RISK 4
ELECTRICAL ISSUES AND HAZARDS - PLANTING UNDER OR
AROUND POWERLINES & ELECTRICAL EQUIPMENT

GETTING STARTED 6
PLANNING – TO AVOID POTENTIAL ELECTRICAL HAZARDS
PLANTING – TO AVOID POTENTIAL ELECTRICAL HAZARDS

APPENDIX A: PLANT HARDINESS INDEX 10
PLANT HARDINESS GEOGRAPHICAL MAP..... 12

DEFINITIONS 13

REFERENCE CHART A: TREE PLANTING ZONES 14
REFERENCE CHART B: BASE ZONE NEAR HYDRO POLES 15

QUICK REFERENCE GUIDE: LANDSCAPE AND ARBORIST TRADES16

LEGAL DISCLAIMER

This document contains AWARENESS ONLY material to assist members of the Public and Industry Professionals to select the correct tree and location to avoid conflicts with the overhead and/or underground powerlines.

This document does not have the force of the law. Where there is a conflict between this document and any Municipal, Regional and/or Township by-laws, legislation or regulation which may apply, the relevant law prevails.

Contact the local Municipality, Regional and/or Township offices to determine if permits are required to plant trees.

Contact your *Local Distribution Company (LDC)* to determine their requirements to plant trees and/or shrubs under or around powerlines and electrical equipment.

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

INTRODUCTION

THE “PLANTING UNDER OR AROUND POWERLINES AND ELECTRICAL EQUIPMENT” GUIDELINE RESPONDS TO THE NUMBER OF REPORTS OF POWERLINE CONTACT INCIDENTS ASSOCIATED WITH THE TRIMMING OR REMOVAL OF TREES, SHRUBS AND VINES. THIS IS ONE OF TWO GUIDELINES PRODUCED BY THE ELECTRICAL SAFETY AUTHORITY WITH THE SUPPORT OF ONTARIO’S *Local Distribution Companies (LDC)* AND CORBAN AND GOODE LANDSCAPE ARCHITECTURE AND URBANISM TO REDUCE ELECTRICAL CONTACT INCIDENTS AND OTHER ELECTRICAL HAZARDS WHEN:

- PLANTING UNDER OR AROUND POWERLINES AND ELECTRICAL EQUIPMENT
- TRIMMING TREES AROUND POWERLINES

THESE GUIDELINES PROVIDES INFORMATION AND INSIGHTS TO SUPPORT LANDSCAPE AND ARBORIST TRADES WORKERS, MAINTENANCE WORKERS, AND HOMEOWNERS. THE GUIDELINES SHARE IMPORTANT INFORMATION ON POTENTIAL ELECTRICAL RISKS, HOW TO AVOID THESE RISKS, PROVINCIAL STANDARDS, AND BEST PRACTICES THAT, IF FOLLOWED, CAN DECREASE ELECTRICAL INCIDENTS.

This guideline includes sections on:

- ELECTRICAL ISSUES AND HAZARDS
- AVOIDING POTENTIAL HAZARDS
 - PLANNING
 - PLANTING

A companion guideline has been created that focuses on avoiding electrical issues and hazards when trimming or removing of trees and/or shrubs under or around overhead powerlines.

WE WOULD LIKE TO ACKNOWLEDGE THE INSIGHTS AND CONTRIBUTIONS OF CORBAN AND GOODE LANDSCAPE ARCHITECTURE AND URBANISM. THROUGH SHARING THEIR INSIGHTS WE HAVE WORKED TO PRODUCE EASY TO USE GUIDELINES FOR AUDIENCES ENGAGING IN LANDSCAPE PLANNING.

ELECTRICAL ISSUES AND HAZARDS - PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

Individuals engaged in planning and/or planting under or around powerlines and electrical equipment, such as Landscape Architects, Landscapers, Municipalities or the public need to be aware of the electrical hazards associated with planting in the vicinity of powerlines or electrical equipment.

TREES

Some species grow at a rapid rate and at a height which directly interferes with overhead powerlines. Planting the wrong tree under or around overhead powerlines create hazards to members of the public and workers. These include:

↳ Potential Hazard or Electrocutation from:

- **direct contact** - when playing in or working around trees where powerlines are hidden by foliage.
- **energized objects** - branches and limbs caught in the powerlines may unexpectedly become conductive.
- **contact with powerlines** - during tree maintenance, trimming or removal, including direct contact by unqualified individuals and contact through tree trimming tools.
- **downed powerlines** – when energized powerlines are pulled down to the ground by broken branches and limbs.



↳ **Potential Fires** - branches and limbs in close proximity to powerlines can lead to electrical arcing that can create fires.

↳ **Power interruptions** – resulting when branches and limbs that break damaging powerlines during storms or from disease.

When selecting trees for planting, it is important to consider location of overhead powerlines, the growth rate for specific varieties based on the environment and placement.

Qualified *Utility arborists* should do maintenance on trees near overhead powerlines. Any other Landscaper, Arborist, or homeowner should contact the *LDC* to arrange for power to be disconnected prior to starting work.

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

SHRUBS

Planting shrubs and other plant material near electrical equipment can:

- ↳ cause an obstruction for powerline maintenance workers;
- ↳ disguise potential hazards;
- ↳ cause damage to underground powerlines;
- ↳ contact energized components through the roots possibly becoming energized.



Obstruction around a transformer

VINES

Planting vines at the base of a powerline pole or guy wire will eventually creep and come into contact with energized overhead powerlines or electrical equipment. Vines in contact with powerlines can become energized and be a hazard to the public, cause power interruptions, or fires.



Pole growth contacting electrical equipment & powerlines

Guy-wire growth contacting electrical equipment & powerlines



GETTING STARTED - PLANNING & PLANTING TO AVOID POTENTIAL ELECTRICAL HAZARDS

Trees, shrubs and plant materials help homeowners and business owners create a property that they can enjoy and benefit from. Before starting, it is important to locate overhead and underground powerlines, and to understand the impact of landscape plans on the electrical infrastructure and electrical equipment. Up-front consideration of electrical powerlines and equipment can avoid potential electrical hazards that can occur from contact between trees, shrubs and roots, and electrical powerlines and equipment.

BEFORE YOU START ANY LANDSCAPE PLANNING, CHECK FOR:

- ☑ MUNICIPAL, REGIONAL OR TOWNSHIP BY-LAWS that specify preferred tree species and locations for planting.
- ☑ LDC REQUIREMENTS regarding planting under or around the overhead powerlines or around underground equipment including underground powerlines.
- ☑ EASEMENTS THAT MAY BE ON THE PROPERTY. *Easements* may contain underground and/or overhead powerlines and electrical equipment which allows the LDC the legal right to access properties to install and maintain electrical services to the property and/or neighbourhood. A land title search will identify if there are existing *easements*.

UNDERGROUND POWERLINES


- ☑ Underground powerlines exist in rural, urban and industrial environments and can be compromised when excavating if these powerlines have not been located prior to excavating. The LDC can provide a 'locate' to identify the location of **their** powerline assets. If powerlines are privately owned, the property owner, and/or excavator or landscaper, will need to make special arrangements to locate underground powerlines. Also, contact other utilities, such as natural gas, water, cable, and telephone, to ensure you are aware of their underground equipment and clearance requirements.

NOTE: driving stakes in the ground for tree support also requires *locates* also to be done.

For locate request, call ahead and allow a minimum of 2 weeks to receive all *locates*. All *locates* must be received prior to excavation.

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

- ↳ Powerlines may be directly buried, or in conduit, and can be located at different depths depending on grade changes that may have occurred. When planting in the vicinity of underground powerlines, the minimum clearance required from the edge of the root ball to the edge of the underground powerline corridor is 1.0m (3 ft). The *LDC* can provide their clearance requirements from the underground powerlines to the root ball. If the determined distance cannot be achieved, the *LDC* may require the installation of a *root deflector* against the root ball.

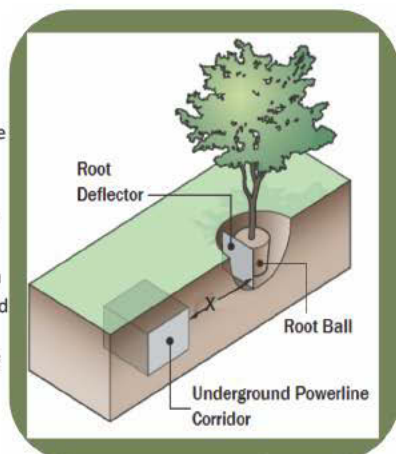

ACKNOWLEDGEMENT-HYDRO OTTAWA

ELECTRICAL EQUIPMENT - ABOVE GROUND MOUNTED OR UNDERGROUND CHAMBER

Depending on the *LDC*, electrical equipment such as a transformer or switchgear, may be above ground mounted on a concrete pad foundation (*pad mounted*) or in an underground chamber. *Pad mounted* electrical equipment, are typically green in color. Obstructions such as structures, fences, trees, shrubs or other vegetation should **not** be placed near the equipment. Clearance is required around the *pad mounted equipment* and underground cables for your safety and the safety of Utility workers who require access at all times.



Pad mounted transformer



Pad mounted switchgear



Underground Chamber

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

- ↳ Typically the *LDC* requires a minimum of 3.0 m (10 ft) in front of the pad mounted transformer door(s) and 1.5 m (4.9 ft) around the sides and back. The door(s) can be identified by the padlock. Pad mounted switchgears however requires a minimum of 3.0m (10 ft) in the front and at the back doors of the unit and 1.5 m (4.9 ft) at the sides.
- ↳ You should also be aware of the presence of a buried 'ground loop' that is installed approximately 1.0 m (3ft) around the perimeter of the foundation and the minimum of 2 ground rods located at the outside corners of this 'ground loop'. The 'ground loop' protects the public and workers from potential hazards associated with ***step and touch potential*** that can exist from fault conditions.




OVERHEAD POWERLINES

- ☑ Considering overhead powerlines is critical in the planning and planting of large trees and shrubs. The *LDC* can assist in identifying the type of powerline:
 - ↳ Primary distribution and transmission powerlines – these are typically non-insulated **bare** conductors and carry high voltage power.
 - ↳ Secondary distribution powerlines – these may be insulated and carry low voltage power.
- ☑ Planting under or around powerlines requires caution to ensure:
 - Delivery of Plant Materials - trees that are being planted should not be delivered under or around the powerlines. Delivery equipment such as a boom truck can come into contact with the overhead wires. The same for digging with equipment such as a high hoe, the equipment can also come into contact with the overhead wires.
 - Trees do not come in contact with overhead powerlines when unloading.
- ☑ A careful review of the tree planting zone in which your landscape project is in will assist in determining the type of trees that can be considered. Tree planting is categorized in 3 different zones; Low, Medium and Tall. Factoring these zones into landscape plans will ensure that the tree at full maturity doesn't come into contact with the overhead powerlines, and will not compromise powerlines if branches and limbs are broken during extreme weather.

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

- ☑ To ensure accuracy determining the height and width at maturity, it is important to consider the *Plant Hardiness Index* accompanied with the *Plant Hardiness Geographical Map* (Appendix A). This will confirm where you can plant the specie of tree in proximity to overhead powerlines.

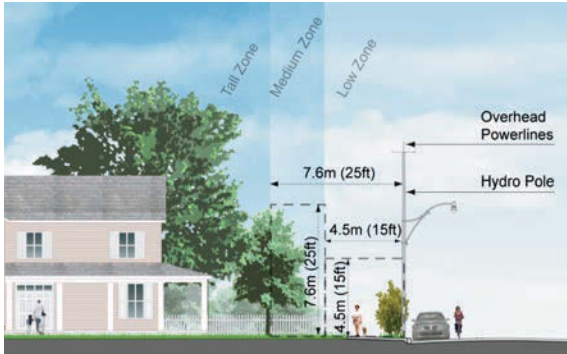


Low Zone - is the area under the power lines and extends to 4.5 m (15 ft) on either side. Trees and/or shrubs planted in this zone should have a maximum mature height and spread of 4.5 m (15 ft).

Medium Zone- extends from the edge of the outer edge of the Low Zone to a distance of 7.6 m (25 ft) on either side of the power line. The maximum mature height and spread of trees planted in this zone should be 7.6 m (25 ft).

Tall Zone – extends from the outer edge of the Medium Zone extending greater than 7.6 m (25 ft) from the power lines. Any strong and healthy tree may be planted in this zone.

Base Zone near the Hydro Pole - Trees and/or shrubs should not be placed closer than 3.0 m (10 ft) from the base of a hydro pole.

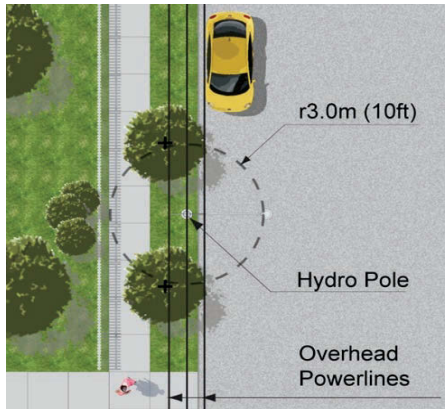

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

APPENDIX A: PLANT HARDINESS INDEX

Geographical Area												LOW ZONE – SMALL TREES					
0a	0b	1a	1b	2a	2b	3a	3b	4a	4b	5a	5b	6a	6b	Latin Name	Common Name	SPREAD (m)	HEIGHT (m)
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Acer ginnab</i>	Amur Maple	4.5	4.5
														<i>Amelanchier laevis</i>	Allegheny Serviceberry, Tree Form	4.0	4.5
														<i>Cornus kousa</i>	Chinese Flowering Dogwood Tree Form	3.5	4.5
														<i>Cornus florida 'Rubra'</i>	Pink Flowering Dogwood Tree Form	4.5	4.5
														<i>Magnolia Stellata</i>	Star Magnolia Tree Form	4.0	3.0
														<i>Malus cultivars</i>	Crab Apple varieties	2.5 - 4.0	4.5
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Prunus virginiana 'Schubert'</i>	Schubert Chokecherry Tree Form	4.0	4.5
Geographical Area												MEDIUM ZONE – MEDIUM TREES					
0a	0b	1a	1b	2a	2b	3a	3b	4a	4b	5a	5b	6a	6b	Latin Name	Common Name	SPREAD (m)	HEIGHT (m)
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Acer ginnab</i>	Amur Maple 'Flame'	7.0	7.0
														<i>Aesculus gbbra</i>	Ohio Buckeye	7.0	7.5
														<i>Amelanchier canadensis</i>	Shadblow Serviceberry/Juneberry, Tree Form	3.0	7.5
														<i>Amelanchier x grandiflora 'Autumn Brilliance' (PP5717)</i>	, Tree Form	5.0	7.5
														<i>Cercis Canadensis</i>	Eastern Redbud Tree Form	7.0	7.5
														<i>Cataegus phaenopyrum</i>	Washington Hawthorn Tree Form	7.0	7.5
														<i>Koeleria paniculata</i>	Golden Rain Tree	7.0	7.5
														<i>Malus cultivars</i>	Crab Apple varieties	5.0 - 7.0	7.0
														<i>Malus 'Robinson'</i>	Robinson Crab Apple	7.5	7.5
														<i>Malus 'Sekirk'</i>	Sekirk Crab Apple	7.5	7.5
														<i>Malus 'Winter Gold'</i>	Winter Gold Crab Apple	6.0	7.5
														<i>Prunus sargentii 'Rancho'</i>	Columnar Sargent Cherry	3.0	7.5
														<i>Prunus serrulata 'Kwanzan'</i>	Kwanzan Oriental Cherry	5.0	7.0
														<i>Pyrus calleryana 'Aristocrat' (PP3193)</i>	Aristocrat Callery Pear	7.0	7.5
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Syringa reticulata 'Ivory Silk'</i>	Ivory Silk Tree Lilac	5.0	7.5
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Viburnum lentago</i>	Nannyberry Tree Form	7.5	7.5


* *Malus cultivars* come in a variety of species. Select the specie's maximum height for the specific planting zone

PLANTING UNDER OR AROUND POWERLINES & ELECTRICAL EQUIPMENT

APPENDIX A: PLANT HARDINESS INDEX-CONT'D

Geographical Area											TALL ZONE – TALL TREES						
0a	0b	1a	1b	2a	2b	3a	3b	4a	4b	5a	5b	6a	6b	Latin Name	Common Name	SPREAD (m)	HEIGHT (m)
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Acer campestre</i> , Hedge Maple		10.0	10.0
										✓	✓	✓	✓	<i>Acer x freemanii</i> 'Armstrong', Armstrong Maple		8.0	15.0
														<i>Acer x freemanii</i> 'Jeffersred' (PP4864), Autumn Blaze Maple		13.0	16.0
														<i>Acer x freemanii</i> 'Cezlam' (PP7279), Celebration Maple		8.0	15.0
														<i>Acer x freemanii</i> 'Scarsen', Scarlet Sentinel Maple		8.0	15.0
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Acer negundo</i> , Manitoba Maple ^f		15.0	13.0
														<i>Acer nigrum</i> , Black Sugar Maple		12.0	15.0
														<i>Acer platanoides</i> , Norway Maple		10.0	13.0
														<i>Acer pseudoplatanus</i> , Sycamore Maple		8.0	13.0
							✓	✓	✓	✓	✓	✓	✓	<i>Acer rubrum</i> , Red Maple		15.0	16.0
														<i>Acer rubrum</i> 'Karpick', Karpick Red Maple		7.0	12.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Acer saccharinum</i> , Silver Maple		15.0	18.0
														<i>Aesculus hippocastanum</i> , Common Horse Chestnut		16.0	18.0
														<i>Carpinus betulus</i> , European Hornbeam		13.0	20.0
														<i>Carpinus betulus</i> 'Fastigiata', Pyramidal European Hornbeam		4.0	12.0
														<i>Catalpa speciosa</i> , Northern Catalpa		6.0	12.0
														<i>Cedrasis lutea</i> , Yellowwood		10.0	12.0
														<i>Crataegus crus-galli</i> var. <i>inermis</i> , Thornless Cockspur Hawthorn Tree Form		10.0	10.0
				✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	<i>Celtis occidentalis</i> , Common Hackberry		18.0	20.0
														<i>Celtis occidentalis</i> 'Prairie Pride', Prairie Pride Hackberry		12.0	12.0
														<i>Cercidiphyllum japonicum</i> , Katsura Tree		7.0	15.0
														<i>Corylus colurna</i> , Turkish Hazel		8.0	15.0
														<i>Fagus grandifolia</i> , American Beech		20.0	30.0
														<i>Fagus sylvatica</i> , European Beech		12.0	15.0
														<i>Ginkgo biloba</i> , Maidenhair Tree		11.0	17.0
														<i>Ginkgo biloba</i> 'Autumn Gold', Autumn Gold Maidenhair Tree		10.0	10.0
														<i>Ginkgo biloba</i> 'JFS-UGAZ', Golden Colonnade™ Maidenhair Tree		8.0	15.0
														<i>Ginkgo biloba</i> 'Princeton Sentry', Princeton Sentry Maidenhair Tree		5.0	13.0
														<i>Gleditsia triacanthos</i> var. <i>inermis</i> , Common Thornless Honeylocust		13.0	17.0
														<i>Gleditsia triacanthos</i> var. <i>inermis</i> 'Impcole', Imperial Honeylocust		10.0	10.0
														<i>Gymnocladus dioica</i> , Kentucky Coffee Tree		13.0	17.0
														<i>Liquidambar styraciflua</i> , Sweetgum		12.0	15.0
														<i>Liriodendron tulipifera</i> , Tulip Tree		15.0	25.0
														<i>Liriodendron tulipifera</i> 'Fastigiatum', Columnar Tulip Tree		5.0	15.0
														<i>Magnolia x galaxy</i> , Galaxy Magnolia Tree Form		6.0	12.0
														<i>Magnolia x loebneri</i> 'Merrill', Merrill Magnolia Tree Form		10.0	13.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Nyssa sylvatica</i> , Black-Gum		10.0	16.0
														<i>Phellodendron amurense</i> , Amur Cork Tree		9.0	13.0
														<i>Platanus x acerifolia</i> 'Bloodgood', London Plane Tree		13.0	16.0
														<i>Pyrus calleryana</i> 'Bradford', Bradford Gallery Pear		7.0	13.0
														<i>Pyrus calleryana</i> 'Capital', Capital Gallery Pear		4.0	11.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Quercus macrocarpa</i> , Burr Oak		13.0	18.0
														<i>Quercus palustris</i> , Pin Oak		13.0	25.0
														<i>Quercus robur</i> , English Oak		13.0	18.0
														<i>Quercus rubra</i> , Red Oak		15.0	16.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Robina pseudoacacia</i> 'Bessoniana', Bessoniana Black Locust		6.0	10.0
														<i>Robina pseudoacacia</i> 'Frisia', Frisia Black Locust		8.0	13.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Tilia americana</i> , Basswood		13.0	25.0
														<i>Tilia americana</i> 'Redmond', American Linden		10.0	20.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Tilia cordata</i> 'Greenspire', Greenspire Littleleaf Linden		12.0	16.0
														<i>Tilia tomentosa</i> , Silver Linden		15.0	23.0
						✓	✓	✓	✓	✓	✓	✓	✓	<i>Ulmus americana</i> 'Princeton', Princeton Hybrid Elm		16.0	23.0
														<i>Ulmus 'Frontier'</i> , Frontier Hybrid Elm		10.0	13.0
														<i>Ulmus parvifolia</i> , Chinese Elm or Lacebark		10.0	13.0
														<i>Ulmus x 'Pioneer'</i> , Pioneer Hybrid Elm		15.0	25.0
														<i>Zelkova serrata</i> , 'Musashino' Zelkova		5.0	15.0
														<i>Zelkova serrata</i> , Green Vase Zelkova (PP5080)		13.0	16.0

APPENDIX A: PLANT HARDINESS GEOGRAPHICAL MAP

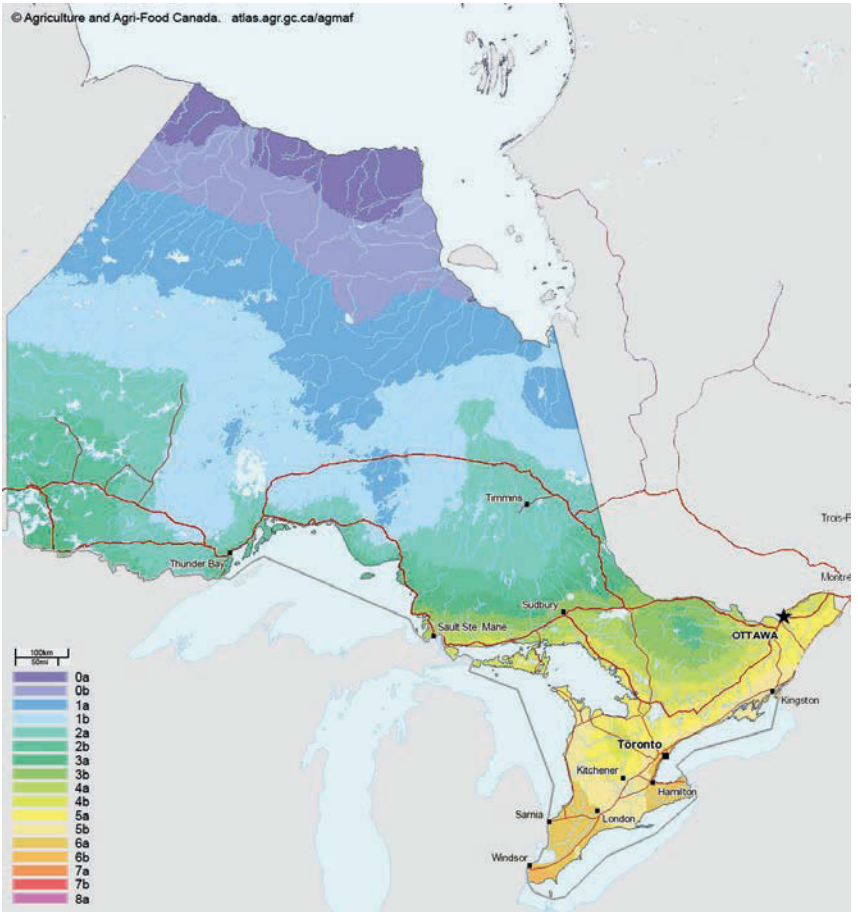

DEFINITIONS

Easement - a right granted to a *LDC* on property owned by others to use their property to support the distribution of electricity. Easements may contain underground and/or overhead powerlines and electrical equipment which requires the *LDC* to have legal access to property for maintenance and installation of electrical services.

Limits of Approach - specifies the required distance between workers and equipment to energized overhead electrical lines and conductors with a nominal phase-to-phase voltage rating set. The *LDC* should be contacted to define the voltage rating for overhead powerlines where work is being done.

Local Distribution Company (LDC) – A Distributor who is licensed under the Ontario Energy Board (OEB) responsible for transmitting electricity to municipal infrastructure including general public and public area.

Locates- Requesting of information from a facility owner identifying all their underground facilities by the use of surface markings such as coloured spray paint or flag identifiers, maps or drawings.

Pad mounted Equipment- Electrical equipment approved to be installed above ground on a concrete foundation.

Plant Hardiness Index- is a geographically defined area in which a specific category of plant life is capable of growing, as defined by climatic conditions, including its ability to withstand the minimum temperatures of the geographical area.

Root Deflector- Is a mechanical barrier placed between the tree roots and the electrical cables to prevent damage to the cables. A root deflector can be made from 6.5 mm (1/4") rigid plastic, fibreglass or non-degradable material.


Step Potential- Is the voltage entering a person from one foot through the body and exiting the other foot standing near an energized ground object.

Touch Potential- Is the voltage entering a person and exiting the body through the feet while contacting an energized object.

Utility Arborist - HAVE COMPLETED THE UTILITY ARBORIST APPRENTICESHIP PROGRAM UNDER THE MINISTRY OF TRAINING COLLEGES AND UNIVERSITIES 444B CERTIFICATE OF QUALIFICATION - AND ARE AUTHORIZED TO PRUNE, CLEAR VEGETATION, FELL OR REMOVE TREES WITHIN THE ONTARIO OCCUPATIONAL HEALTH & SAFETY ACT (ONT. OH&S ACT) DEFINED '*LIMITS OF APPROACH*'.


REFERENCE CHART A: TREE PLANTING ZONES

TREE PLANTING ZONES

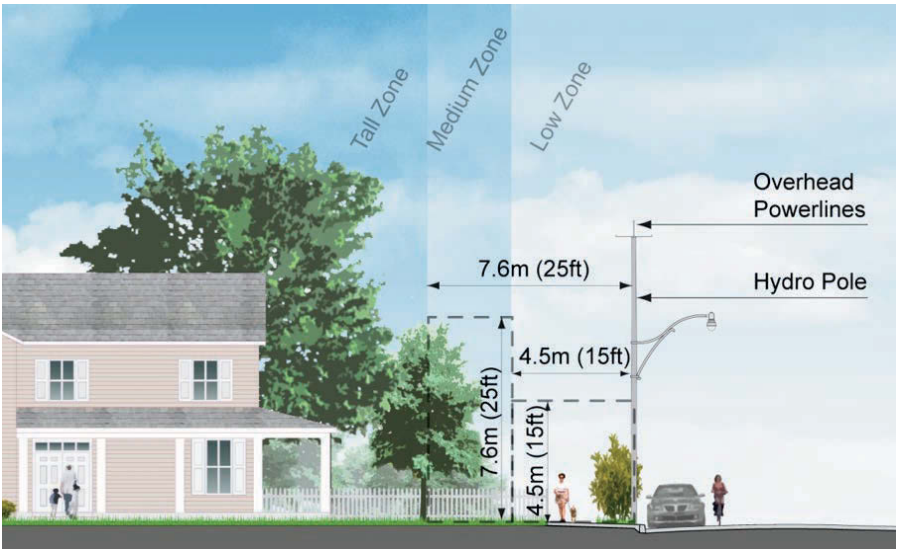

REFERENCE CHART B: BASE ZONE NEAR HYDRO POLES

BASE ZONE NEAR HYDRO POLES

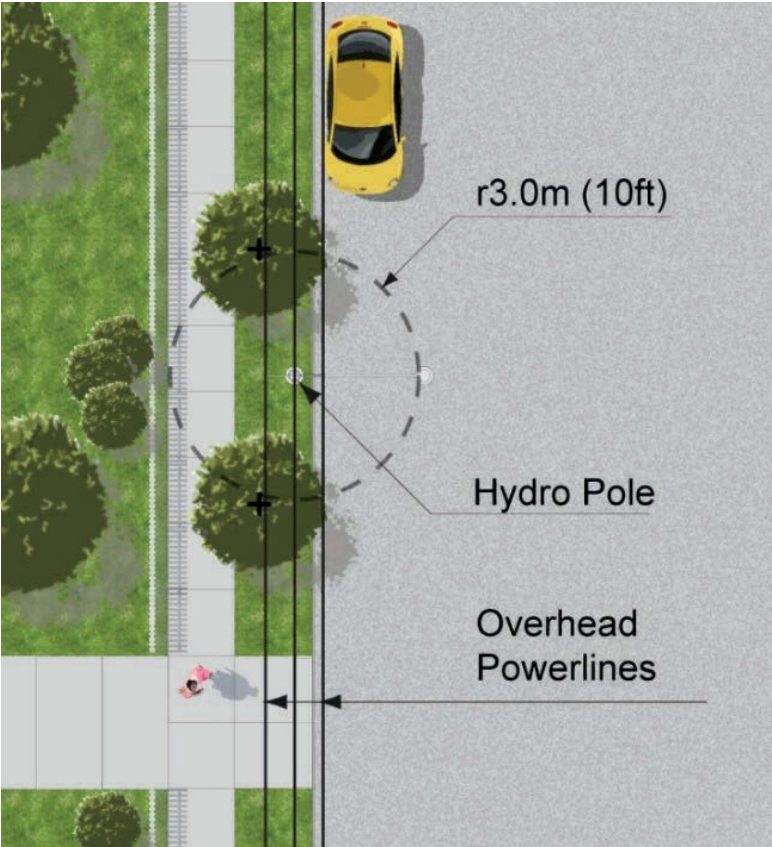

QUICK REFERENCE GUIDE: LANDSCAPE & ARBORIST TRADES

‘LOOK UP! LOOK OUT!’ TO AVOID POTENTIAL ELECTRICAL HAZARDS

- ☑ LOCATE OVERHEAD POWERLINES AND FOLLOW ONT. OH&S ACT’S LIMITS OF APPROACH
- ☑ LOCATE ALL UNDERGROUND SERVICES PRIOR TO EXCAVATING

Allow a minimum of 2 weeks to receive all *locates*. All locates must be received prior to excavation.

- ☑ CHECK MUNICIPAL, REGIONAL AND TOWNSHIP BY-LAWS FOR SPECIFICATIONS
- ☑ CHECK WITH THE LDC FOR THEIR PLANTING REQUIREMENTS UNDER OR AROUND POWERLINES AND ELECTRICAL EQUIPMENT INCLUDING UNDERGROUND POWERLINES
- ☑ SELECT LANDSCAPE MATERIALS AND DESIGNS THAT MEET CLEARANCE REQUIREMENTS UNDER OR AROUND POWERLINES AND ELECTRICAL EQUIPMENT, SPECIFICALLY:

⇒ **UNDERGROUND POWERLINES** - THE MINIMUM CLEARANCE REQUIRED FROM THE EDGE OF THE ROOT BALL TO THE EDGE OF THE UNDERGROUND POWERLINE CORRIDOR IS 1.0 M (3FT.)

⇒ **ELECTRICAL EQUIPMENT** - WHEN PLANTING NEAR *PAD MOUNTED EQUIPMENT*:

- **TRANSFORMERS** - 3.0 M (10 FT.) IS REQUIRED IN FRONT OF THE DOOR(S) AND 1.5M (4.9 FT.) ON THE SIDES AND BACK
- **SWITCHGEAR** - 3.0 M (10 FT.) IS REQUIRED IN THE FRONT AND BACK DOORS AND 1.5M (4.9 FT.) ON THE SIDES

⇒ **OVERHEAD POWERLINES** – ‘LOOK UP! LOOK OUT!’

1. CONSIDER REQUIRED DISTANCES BETWEEN POWERLINES AND TREES OR SHRUBS WHEN SELECTING SPECIES.

- ⇒ **LOW ZONE** - IS THE AREA UNDER THE POWER LINES AND EXTENDS TO 4.5 M (15 FT) ON EITHER SIDE. TREES AND/OR SHRUBS PLANTED IN THIS ZONE SHOULD HAVE A MAXIMUM MATURE HEIGHT AND SPREAD OF 4.5 M (15 FT).
- ⇒ **MEDIUM ZONE** - EXTENDS FROM THE OUTER EDGE OF THE LOW ZONE TO A DISTANCE OF 7.6 M (25 FT) ON EITHER SIDE OF THE POWER LINE. THE MAXIMUM MATURE HEIGHT AND SPREAD OF TREES PLANTED IN THIS ZONE SHOULD BE 7.6 M (25 FT).
- ⇒ **TALL ZONE** – EXTENDS FROM THE OUTER EDGE OF THE MEDIUM ZONE EXTENDING GREATER THAN 7.6 M (25 FT) FROM THE POWER LINES. ANY STRONG AND HEALTHY TREE MAY BE PLANTED IN THIS ZONE.
- ⇒ **BASE ZONE NEAR HYDRO POLES** - TREES AND/OR SHRUBS SHOULD NOT BE PLACED CLOSER THAN 3.0 M (10 FT) FROM THE BASE OF A HYDRO POLE.

2. DELIVERY OF PLANT MATERIALS - UNLOADING OF THE TREE(S) IS NOT TO BE DONE UNDER OR AROUND THE OVERHEAD POWERLINES. DELIVERY EQUIPMENT SUCH AS A BOOM TRUCK CAN COME INTO CONTACT WITH THE OVERHEAD WIRES. THE SAME FOR DIGGING WITH EQUIPMENT SUCH AS A HIGH HOE, THE EQUIPMENT CAN ALSO COME INTO CONTACT WITH THE OVERHEAD WIRES.